


2026-2028

MINIMUM REQUIRED Matting At least 4 3/4"

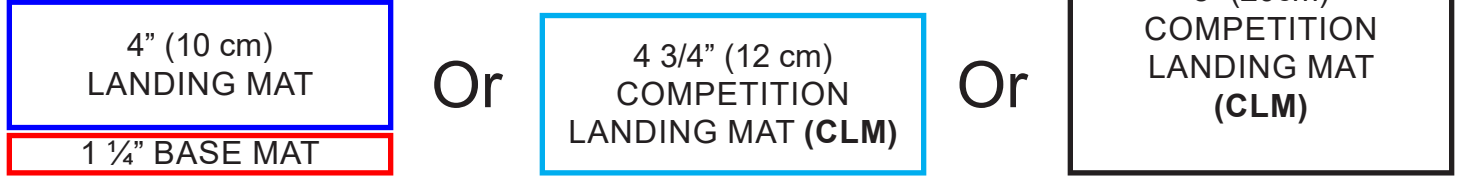

(Base mat may be under or over any landing mat)

MAXIMUM ALLOWABLE Matting

any combination of matting not to exceed 19 inches (48 cm)

VAULT BOARD, FOLDED PANEL MAT OR MOUNT TRAINER MAT MAY BE USED FOR MOUNTING AND MAY BE PLACED ON

One or two 10 cm or 12 cm mats **or** a 20 cm **CLM** mat.

In addition, an up to 4" (10 cm) skill cushion **or** sting mat may be added.



A mounting device may **not** be placed on top of another mounting device.

Trampoline-like and inflatable rebound devices are **not** permitted.

A vault board may **not** be placed on an 8" **skill** cushion.

A folded panel mat **or** a mount trainer mat **may** be placed on an 8" skill cushion.

"Pit Pillows"
(min 4'x6'x8")
are allowed on all
events for warm-ups
and on bars
during competition
for releases only.

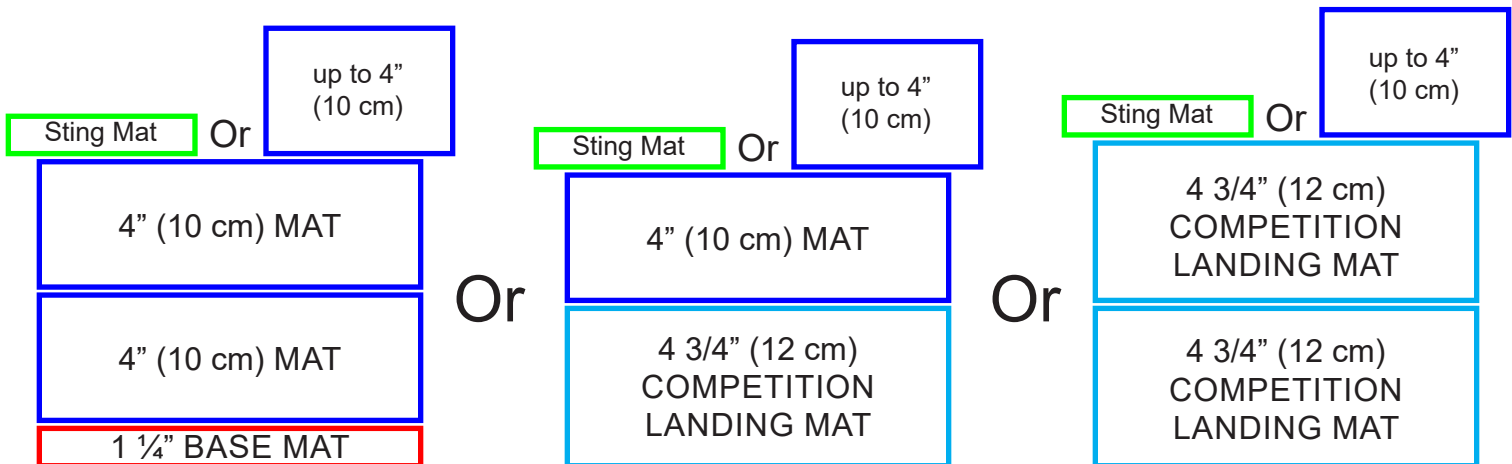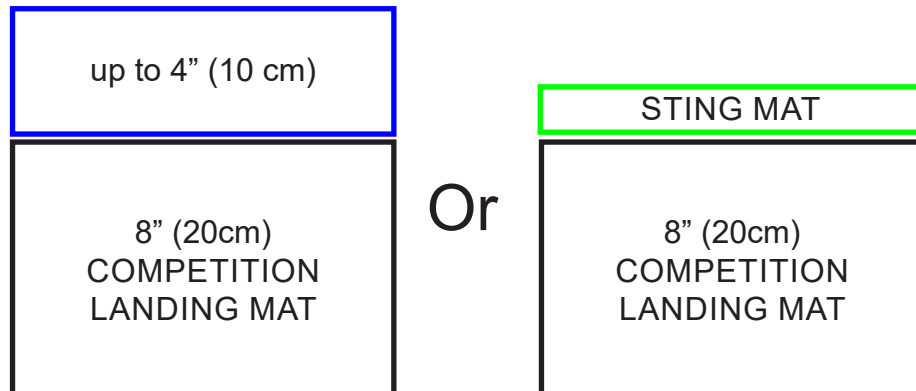

Floor Exercise—Up to 2 mats (up to 8") may be placed separately on the FX area for any element (only one per acro pass). A sting mat may be placed on top of or under an up to 8" skill cushion (including another sting mat) and the combination of the two mats will be counted as one additional mat. If either mat is removed, it may not be placed back on the floor. **Mats must be placed prior to start of routine.**